

**NOTICE INVITING TENDER**

Sealed tenders are invited from contractors for “**Laying of 3 x400 sqmm 11KV new XLPE cable for factory connection at ITI Limited Mankapur.**”

Name of work	Estimated Cost (Lakh Rs.)	Earnest Money (Rs)	Sale starts/ Close on	Date of receipt / opening of tender documents	Cost of Tender documents (Rs)
Laying of 3 x400 sqmm 11KV new XLPE cable for factory connection at ITI Limited Mankapur.	1.71	3500.00	22/09/2020 to 08/10/2020	22/09/2020 at 11.00hrs ./ 09/10/2020 at 11.30 hrs	500.00

**Tenders will be accepted under the two-bid system as below: -**

1. The tender shall be submitted in two parts i.e. Envelop I and envelop II each in a separate sealed envelope subscribed for Envelop I and envelop II shall be kept in a separate envelope subscribing tender ID no. LPE0088R Due date **09/10/2020** Envelop II will be opened only if the tender is found technically suitable.
2. The Tender documents may be downloaded from the website of the company and the Tenderer shall be required to deposit the tender documents cost with the tender submitted. Tender documents may also be issued on the request of the interested parties from the office of Manager (PE) or Chief Manager (CS) in the factory Area from on any working days during office working hours (9.00 AM to 5.00 PM) against submission of Crossed Indian Postal order / Bank Draft for Rs. 500.00 payable at Mankapur in favour of ITI Township, Branch, Mankapur (Bank Code No.8549 in favor of ITI Ltd., Mankapur).
  - I. Tender will be received in the office of the Manager (Tender Cell) ITI LTD, Mankapur, Gonda-271308 up to 11 AM on dated **09/10/2020** and will be opened on the same day at 11.30 AM.
  - II. Important Notes: In case of tender are being submitted through e-mail, following guidelines must be followed.
    - a) The e-mail quotations/offers may be submitted as attachment (s) at Email: **newtender\_mkp@itilttd.co.in**. The attachment (s) must be .pdf/. doc/.xls.jpg/.tif type file.



Ref.: ESSM/PE/HDPE/2020-21/

Date: 21/09/2020

- b) **No copy (CC) of quotations/offers should be sent to any other e-mail-ID of ITI Limited.**
- c) The subject line of the e-mail for offer/quotations must contain Tender ID No. LPE 0088 and due date **09/10/2020**. Offer shall not be considered in case of violation of above instruction.
- d) Tenders received after due date & time will not be considered.
- e) Interested bidders may participate in tender opening.
- 3. The technical bid in Envelope No. 1: Eligibility criteria:** (Attached proof documents for all the points) all documents submitted duly stamped and signed and stamped by bidder as token of acceptance. Envelop no.1 should contain the following documents:
- a) Satisfactory completion certificate, copy of work order from competent authority not below the rank of Executive Engineer for similar type of work done in the last three years for an equal amount in single order. However, working contractors of ITI Limited will be eligible to participate in the bid if the cost of single tender executed by them in 50% of this NIT being called for.
- a) Photocopy of PAN Card / GSTIN Registration certificate.
- b) Cost of tender fees in form of IPO / DD in case of tender downloaded from web site.
- c) **Earnest money** Rs.3500.00(Rs.Three thousand five hundred only) shall be deposited along with the tender by way of Demand Draft from Nationalized Bank payable in favour of ITI Limited payable at Mankapur, (SBI ITI Township Branch Code 8549). Tender without earnest money deposit shall not be considered and will be rejected.
- d) A Class electrical contractor permit.
- e) Terms & Condition, Technical document It should contain all documents except priced BOQ.
- f) Deviations if any from NIT and eligibility criteria shall not be entertained.
- g) Un-priced bill of quantity mentioning 'quoted / not quoted'.

**NOTE: Bidders not meeting above eligibility criteria or not submitted requisite documents in support with necessary evidence will be liable for rejection and will not be considered for technical and commercial evaluation.**

- 4. The Price Bid in Envelop No.2:** should containing, the rates in our bill of quality, duly signed and stamped as token of acceptance.
5. Both the above envelope should be sealed & shall be subscribing **Tender ID No, Opening Date & Time**. The Tender should be addressed to **“Manager Tender Cell, Computer Division, ITI Limited, Mankapur, Dist: GONDA (UP), PIN CODE 271 308** and should be kept in sealed tender box Kept in Tender Cell marked for Plant Services on or before due date & time.
- 6. Security Deposit:** 10% will be deducted as security for successful completion of work from the bill. The E.M.D deposited will be adjusted in security. The security deducted as above will be refunded after completion of defect liability period or completion of contract after final bill whichever is later.



Ref.: ESSM/PE/HDPE/2020-21/

Date: 21/09/2020

7. **Validity:** The tender shall remain firm and valid for acceptance for 03 months from the last day of opening of the tender.
8. **Completion Period of contract:** will be 45 days months from the 7<sup>th</sup> day of work order. The period of contract may be extended for further period of one month on discretion of ITI Limited Management on the same rates, terms & conditions of the contract.
9. **Defect Liability period:** six months from the date of satisfactory completion of work.
10. **Payment terms:** The payment will be made on the basis of running account bills submitted by the contractor. However, the final bill will be made after successful completion of work.
11. **Earnest money deposit:** Tenderer shall deposit earnest money deposit of Rs.3500.00 (Rs. Three thousand five hundred only) in form of demand draft/banker cheque in favour of M/S ITI Limited, payable at S.B.I., ITI T/S Branch, Mankapur code no.8549. The earnest money deposit of successful bidder will be adjusted in security deposited. The EMD of unsuccessful bidders will be refunded after finalization of Quotation without any interest on the amount.
12. The price bid of only those contractors will be opened who are found technically suitable.
13. ITI Ltd. Reserve the right to accept OR reject any tender or split the tender in any number of parts without assigning any reason thereof.
14. Conditional tenders will not be accepted.
15. The work will be awarded as a whole in single package on L-1 basis.
16. ITI will not be responsible for non – receipt / late receipt OR loss of tenders documents in postal transit.
17. The Tenderer must obtain for himself on his own responsibility and at his own expenses all the information which may be necessary for the purpose of making a tender and for entering in to contract and must examine the drawing if any and must visit the site and inspect the site of the work and acquaint himself with all the local conditions means of access to the work, nature of work and all matters pertaining there to the tenderer deemed to have studied and fully acquainted himself with the working conditions etc. Once the tender submitted for the work, no claim at a later date on account of lack of knowledge of the site and working conditions will be entertained.
18. The tender submitted on the behalf of a firm shall be signed by all the partners or by a partner who has the necessary authority on behalf of the firm to enter into the proposed contract, otherwise the tender is liable is be rejected.
19. All erasers and alterations made while filling the tender must be attested by initial of the Tenderer over writing of figures are not permitted. Failure to comply with either of these conditions will render the tender void. No advice of any change in rate or conditions after opening of tender will be entertained.



ESSM/PE/HDPE/2020-21/

Date: 21/09/2020

20. The rate quoted by Tenderer should clearly mention Goods and Service tax (GST) and other Government Levies if applicable. Otherwise it is assumed that the quoted rates are inclusive of all taxes / Government Levies
21. Tenders will be opened in presence of tender or their authorized representative who may like to be present.

Note: For more details, Tenderer may visit our web site [www.ityltd-india.com](http://www.ityltd-india.com). & <https://tenders.gov.in>. The tender documents can also be downloaded from our website in that case the tender fee, as above, is to be submitted in Envelop No.1. Tenderer must ensure that they are qualifying for participating in tender.

Issuing of Tender document does not mean technically qualified.

P N JHA

Manager (PE)

Email:amelectrical\_mkp@ityltd.co.in

Phone:05265-274430/273864/230184

Fax:05265-2301999/230179



Ref.: ESSM/PE/HDPE/2020-21/

Date: 21/09/2020

**NOTICE INVITING TENDER**

Sealed tenders are invited from contractors for **“Laying of 3 x400 sqmm 11KV new XLPE cable for factory connection at ITI Limited Mankapur.”**

## Table of contents

SL.NO.	Description	Page no.
01	Notice inviting tender	I-1/4 to I-4/4
02	Part – A: General Terms & Conditions	II– 1/3 to II–3/3
03	Part – B: Special Terms and conditions	III-1/2 to III-2/2
03	PART –C: Schedule of Quantity	IV – 1 to IV -2

Tender issued to:

Manager (PE)

Date:

Signature of person issuing tender

**Important**

Tenderer shall satisfy himself before submitting the tender that no paper or document from the tender consisting of above 12 pages is missing.

**Work title: Laying of 3 x400 sqmm 11KV new XLPE cable for factory connection at ITI Limited, Mankapur.**

Ref.: ESSM/PE/HDPE/2020-21/

Date: 21/09/2020

**Part – A (General Terms & Conditions)  
GENERAL TERMS & CONDITIONS**

**Work scope:** The 11KV new 3x400 sqmm XLPE cable required for laying from Sub-station no1 for nearby 132 KV sub-station, Mankapur for factory connection in all respect with standard manner by adopting all regulatory and mandatory norms. The Tenderer is responsible for execution of cable laying work and end termination .

- 1. Security Deposit:** 10% will be deducted as security for successful completion of work from the bill. The E.M.D deposited will be adjusted in security. The security deducted as above will be refunded after completion of defect liability period or completion of contract after final bill whichever is later.
- 2. Validity:** The tender shall remain firm and valid for acceptance for 03 months from the last day of opening of the tender.
- 3. Completion Period of contract:** will be 45 days months from the 7<sup>th</sup> day of work order. The period of contract may be extended for further period of one month on discretion of ITI Limited Management on the same rates, terms & conditions of the contract.
- 4. Defect Liability period:** six months from the date of satisfactory completion of work.
- 5. Payment terms:** The payment will be made on the basis of running account bills submitted by the contractor. However, the final bill will be made after successful completion of work.
- 6. Earnest money deposit:** Tenderer shall deposit earnest money deposit of Rs.3500.00 (Rs. three thousand five hundred only) in form of demand draft/banker cheque in favour of M/S ITI Limited, payable at S.B.I., ITI T/S Branch, Mankapur code no.8549. The earnest money deposit of successful bidder will be adjusted in security deposited. The EMD of unsuccessful bidders will be refunded after finalization of Quotation without any interest on the amount.
- 7. Compensation for delay -Liquidated Damage:** In case of failure compensation for delay will be levied 1% per week of quoted rates subject to the maximum of 5 % of the contract value in specific use where delay in attending the breakdown may incur major loss of company ,will be taken up by ITI with other agency and expenses what so ever along with supervision charges will be adjusted from the outstanding of the contractor.
- 8. The Tenderer must indemnify for himself on his own responsibility and at his own expenses all the information which may be necessary for the purpose of making a tender and for entering in to contract and must examine the drawing if any and must visit the site and inspect the site of the work and acquaint himself with all the local conditions means of access to the work, nature of work and all matters pertaining there to the Tenderer deemed to have studied and fully acquainted himself with the working conditions etc. Once the tender submitted for the work, no claim at a later date on account of lack of knowledge of the site and working conditions will be entertained.**
- 9. The tender submitted on the behalf of a firm shall be signed by all the partners or by a partner who has the necessary authority on behalf of the firm to enter into the proposed contract, otherwise the tender is liable is be rejected.**



**Work title: Laying of 3 x400 sqmm 11KV new XLPE cable for factory connection at ITI Limited, Mankapur.**

Ref.: ESSM/PE/HDPE/2020-21/

Date: 21/09/2020

10. The contractor shall at all times indemnify the company against all claims, damages or compensation under provision of payment of wages Act 1936, minimum wages Act 1948, employer's liability Act 1938, the workmen's compensation Act 1923, Industrial Dispute Act 1947, employees insurance Act 1948 and Maternity Benefit Act 1961 or any modification therefore or any other law relating there to and rules made there under from time to time or consequence of any accident or injury to any workman without his obligation as above provided the contractor shall ensure against all claims, damages or compensation payable under the Workmen's Compensation Act 1923 or any other modification thereof or any other law relating thereto.
11. The contractor will ensure suitable arrangement for gate entry of workers in time accordingly gate passes shall have to be prepared.
12. The work however will be executed subjected to allocation by engineer in charge based on site clearance.
13. The contractor will be required to follow EPF Act, MP Act 1995 and ESI Act.
14. The contractor will take all adequate steps to ensure the safety of workers employed by him.
15. The contractor shall provide all necessary protective equipments and tools to the workers for safe execution of works.
16. In case any worker employed by the contractor prefers claim under workmen Compensation Act, ITI shall be at liberty to recover such amount or any part thereof from the dues of the contractor.
17. In case of any dispute, decision of the Unit Head, ITI Limited Mankapur shall be final and binding on both parties. Courts at Gonda only shall have the jurisdiction in case the matter goes to courts. All disputes shall be resolved sole arbitration appointed by ITI Limited or through IACDR Rule.
18. If the contractor fails to make the payment to the contract labour in time, the ITI shall deduct required amount from the contractor as per minimum wages Act for disbursement of wages.
19. The work is to be prepared as specification, and as per direction of the Engineer in charge.
20. The decision of Engineer in-charge. However, the final will be made after successful completion of work.
21. Sufficient persons have to be posted for the work execution as required .
22. If the contractor fails to execute the work satisfactorily the same can be executed by other party at the risk and cost of the contractor.
23. The rate quoted by Tenderer should clearly mention Goods and service tax (GST) and other Government Levies if applicable. Otherwise it is assumed that the quoted rates are inclusive of all taxes / Government Levies
24. ITI Limited reserves the right to allot the work partially or wholly to single or different contractors.
25. The contractor will take all adequate steps to ensure the safety of workers employed by him.
26. The contractor shall provide all necessary protective equipments and tools to the workers for safe execution of works.
27. The work is to be performed strictly as specification, and as per direction of the Engineer-in-Charge.
28. Bidder must sign all the papers attached here to & submit along with the tender.



**Work title: Laying of 3 x400 sqmm 11KV new XLPE cable for factory connection at ITI Limited, Mankapur.**

Ref.: ESSM/PE/HDPE/2020-21/

Date: 21/09/2020

29. The decision of the Engineer-in-Charge regarding quality and progress of the work will be final and binding.
30. No sub- contract /subletting of the work is allowed at site in case of found so will attract breach of contract.
31. All the excavation work has to be carried out carefully. In case there is any damage in the existing cable (Telephone/Power) it will be the responsibility of the party to rectify the same within two days.
32. All the cable to be handled carefully. Any damage in the cable during the handling shall be the responsibility of contractor and suitable recovery shall be made on this account.
33. Drawing of cable rout/cable identity to be submitted by the contractor after completion of work.
34. Where ever road cutting is involved; contractor has to make the road in good condition.
35. Cutting of the main road shall be avoided for crossing of such road, the laying of cable to be done through boring process below main road.
36. The contractor will have to sign an agreement on a non-judicial stamp paper of Rs 100.00 within 15 days from the date of issue of work order.
37. Other terms & conditions of the tender will be governed by tender documents .
38. All dispute subject to the Gonda Jurisdiction only.

P N JHA

Manager (PE)

Email:amelectrical\_mkp@itilttd.co.in

Phone:05265-274430/273864/230184

Fax:05265-2301999/230179





**Work title: Laying of 3 x400 sqmm 11KV new XLPE cable for factory connection at ITI Limited, Mankapur.**

Ref.: ESSM/PE/HDPE/2020-21/

Date: 21/09/2020

**PART –B: (SPECIAL TERMS AND CONDITIONS)**

1. Day to day cable laying work will be carried out in general working days and permission must be obtained from engineer in charge for working holidays and extra timing with prior information .The General work will be carried out from 9 A M to 5 PM
2. Contractor must furnish the list of staff to be posted by them for different type of work for smooth cable laying.
3. A Supervisor / engineer should always be available at site to monitor the soil excavation work and refilling with bricks and sand with proper manner as required.
4. ITI and contractor will review progress of the work jointly.
5. Material will delivered at the site based on the work requirement after approval and clearance of ITI Limited, Mankapur.
6. All the damage / broken material / unused power cable shall be property of the company and the contractor should deliver the same to ITI Store at his own cost.
7. The contractor has to handle the power cables from store and arrange all required materials at his own cost.
8. Contractor or his authorized representative will required to visit ITI Limited, Mankapur daily at the time fixed by Engineer in Charge.
9. All the Damages During work by contractor if any shall have to be made good by contractor at his own cost.
10. The quality of bricks shall be 'B' class and sand shall have without soil.
11. PCC/GI pipe of adequate size should be laid where the road/ trench are in the route of cable laying.
12. The cable entry at the sub-stations panel/ trench should be through cable tray grouting and fixing /end wall making whole and ceiling after the work.
13. The loops of the cable should be provided by the contractor for jointing and end terminations and cable routes as required without any extra cost.
14. Contractor with all required equipments and items shall carry out the cable jointing for both side end terminations as required in standard and expertise manner. The 11 KV new XLPE power cable and jointing kits will be provided by ITI Limited.
15. The disposal of rubbish dismantled / unserviceable material shall be done to outside the ITI Limited and useful materials any be deposited in the department official store at the cost of contractor as directed by engineer in charge.
16. The contractor will have to execute the work outside the ITI Limited; factory area as directed by Engineer in charge at the rates quoted here in no extra payment will be made on this account.
17. The rates of BOQ are inclusive of T&P for working at all weight & depths and nothing extra will be payable on this account.
18. The lowest of the rates quoted by the contractor for the similar items of BOQ will be considered for payment.
19. Sufficient manpower and required materials are to be kept in the stock for prompt execution of work.
20. Skilled staff having electrician / wireman license and supervisor having supervisory license have to be posted at site.
21. All the Material brought at the sight should be offered for inspection before execution at the site and proof of material brought has to be produced.


**Work title: Laying of 3 x400 sqmm 11KV new XLPE cable for factory connection at ITI Limited, Mankapur.**

Ref.: ESSM/PE/HDPE/2020-21/

Date: 21/09/2020

22. The B&L form and necessary permission from state government offices will be responsibility of the contractor.
23. The shutdown of power supply if required will be obtained from Chief Manager (CS)/ Manger (PE) in advance so that engineer in charge may manage alternate arrangement.
24. The contractor will be arranged for any special tools, safety appliances as required for execution of work.
25. The contractor solely responsible for execution of work outdoor /indoor as and when required with almost care and their strict supervision and under instruction of Engineer –in-charge.

**DRAWING SPECIFICATION OF SINGLE CABLE LAYING**

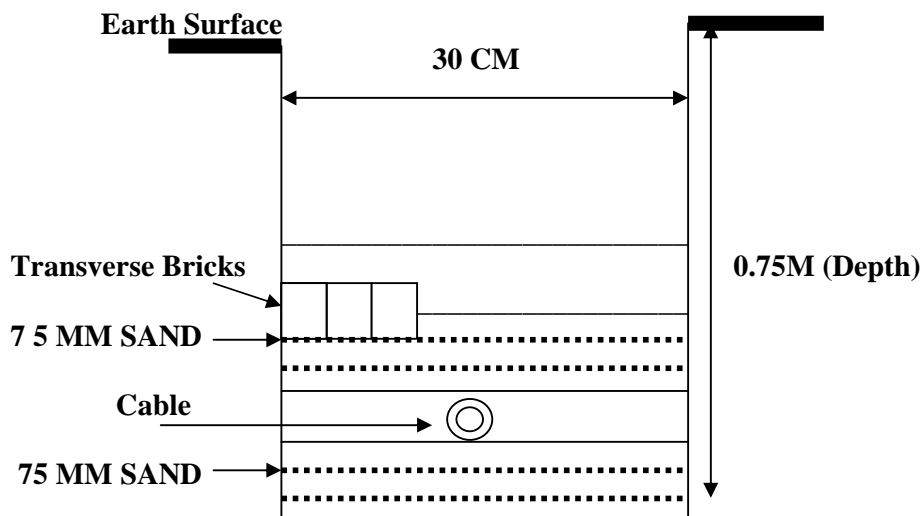

P N JHA

Manager (PE)

Email:amelectrical\_mkp@itilttd.co.in

Phone:05265-274430/273864/230184

Fax:05265-2301999/230179

**Work title: Laying of 3 x400 sqmm 11KV new XLPE cable for factory connection at ITI Limited, Mankapur**

**Part-C: Schedule of Quantity (Bill of Quantity)**

Ref.: ESSM/PE/HDPE/2020-21/

Date: 21/09/2020

PRICE BID

Sl.	Particulars	Unit	Qty	Rate (Rs.)	Amount (Rs.)
1	Cutting of wild trees ,shrubs and removing from the cable route .	Sq. meter	350		
2	Excavation of minimum 75 cm depth,0.5 Meter width and 325Meter length soil for laying of 11 KV new XLPE4 x400 sqmm cable from sub-station no.1 to 132 kv sub-station ,Mankapur in factory area and back filling of soil after cable work completion	Cubic meter	121.88		
3	Supply and Laying of sand 7.5CM (75mm) thick layer well below for cushioning purpose the cable path and same size over the bricks after laying of power cables as required specification manner .	Running meter	325		
4	Laying of 11 KV new XLPE3x400 sqmm power cable and handling from store to site.(Power cable will be provided by ITI Limited.)	Running meter	350		
5	Supply and laying of longitudinal good quality(B Class) bricks over the cable to prevent mechanical damage after laying of 11KV,3x400 sqmm new XLPE power cable.	Nos.	3500		
6	Supply and laying of adequate size PCC pipe(Class NP2) by standard way of excavation /boring method in the drain trench available at 2 Places about 2 meter width and maintain back completion of 11KV,3x400 sqmm new XLPE power cable.	meter	8		

**Work title: Laying of 3 x400 sqmm 11KV new XLPE cable for factory connection at ITI Limited, Mankapur****Part-C: Schedule of Quantity (Bill of Quantity)**

Ref.: ESSM/PE/HDPE/2020-21/

Date: 21/09/2020

7	Supply and Laying adequate size PCC pipe(Class NP2) by standard way of excavation/ boring method for the about 6-15 meter width roads available at 2 Places and maintain back after completion of 11KV,3x400 sqmm new XLPE power cable.	Meter	30		
9	Supply of IER recommended 11 KV danger board and Fixing on HT cable path.	Nos.	5		
10	Total				
11	Discount offered				
12	Total including GST @.....%				
13	<b>Grand Total</b>				
<b>In words Rs.</b>					

**Note: The cable length is 350 meter with +/- 10% including trench ,roads and indoor .**

P N JHA

Manager (PE)

Email:amelectrical\_mkp@itilttd.co.in

Phone:05265-274430/273864/230184

Fax:05265-2301999/230179